


PLAN VIEW
NOT TO SCALE

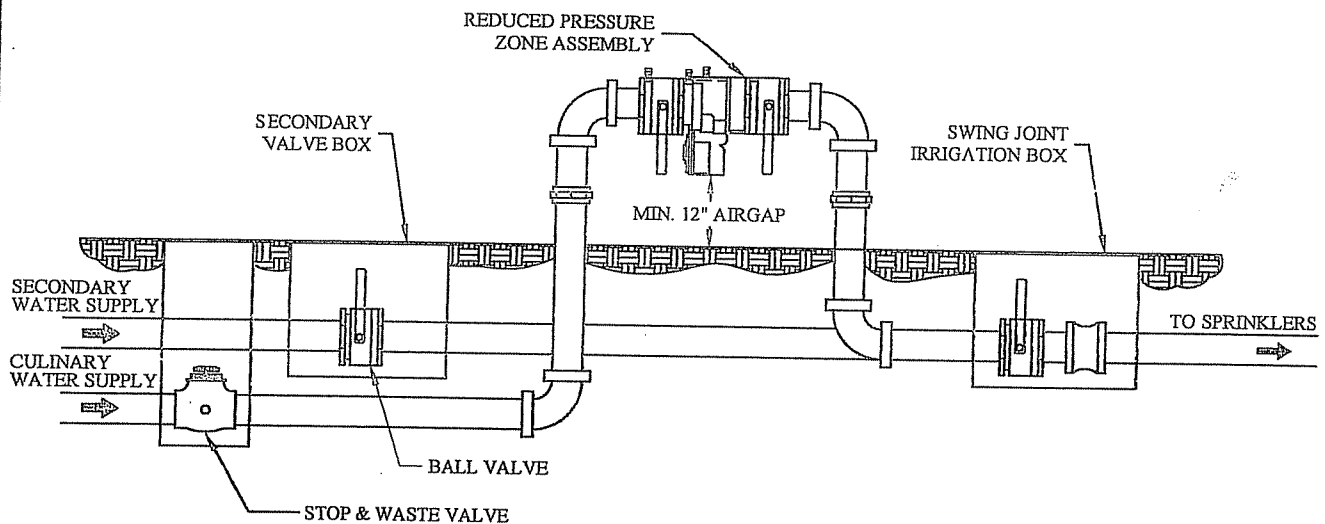

PROFILE VIEW
NOT TO SCALE

NOTES:

1. THE SWING CONNECTION IS INSTALLED SO THAT EITHER THE SECONDARY IRRIGATION WATER OR THE CULINARY WATER IS CONNECTED AND FEEDING THE SPRINKLER SYSTEM AT THE ONE TIME.
2. THE REDUCED PRESSURE ZONE ASSEMBLY MUST BE LOCATED AT A MINIMUM OF 12" FROM WALL, FENCE OR OTHER OBSTACLE.
3. THE REDUCED PRESSURE ZONE ASSEMBLY MUST BE LOCATED AT A MINIMUM OF 12" ABOVE GRADE (NOT ALLOWED IN A PIT BELOW GRADE).
4. THE REDUCED PRESSURE ZONE ASSEMBLY MUST BE INSPECTED BY A CERTIFIED BACKFLOW TECHNICIAN ON AN ANNUAL BASIS.



SOUTH JORDAN CITY

			DRAWN:	SECONDARY & CULINARY WATER IRRIGATION CONNECTION	STANDARD DRAWING 2001
			KS		
			DATE:		
			2/06		
DATE	REVISIONS	BY			